
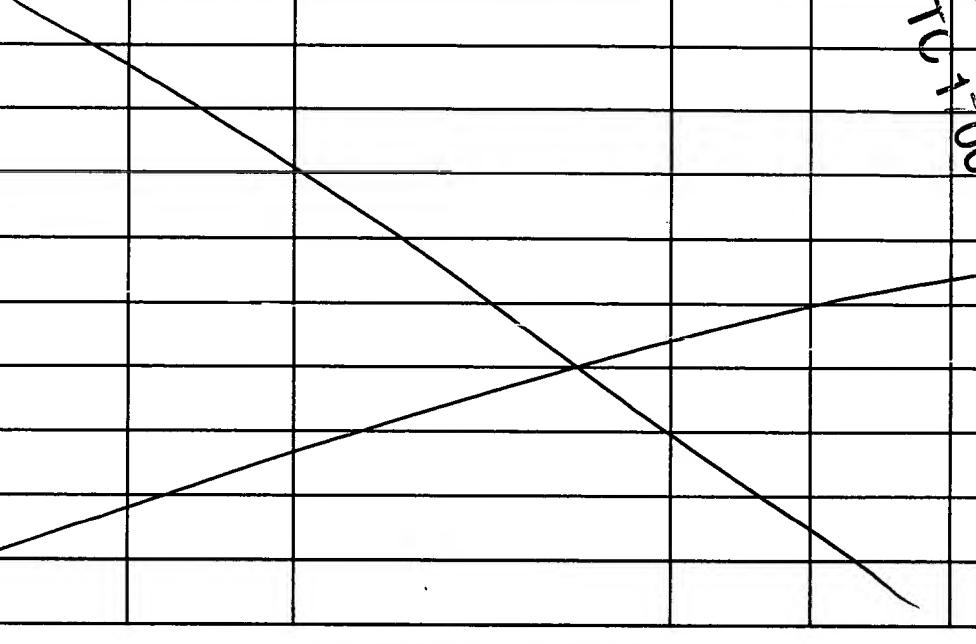
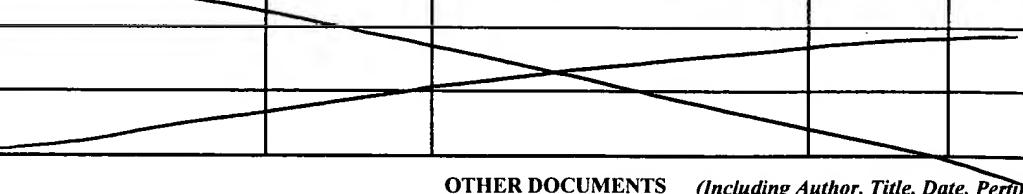


| INFORMATION DISCLOSURE CITATION <i>(Use several sheets if necessary)</i> | | | | Docket Number (Optional) PB-0006 | Application Number 09/808,375 | | |
|--|-----------------|--|-----------|--|---|--------------|----------------------------|
|  NOV 26 2001 | | | | Applicant(s) S. Liu | | | |
| | | | | Filing Date March 14, 2001 | Group Art Unit 1743 | | |
| U.S. PATENT DOCUMENTS | | | | | | | |
| *EXAMINER INITIAL | REF | DOCUMENT NUMBER | DATE | NAME | CLASS | SUBCLASS | FILING DATE IF APPROPRIATE |
| <i>AN</i> | A1 | 6,017,434 | 25-Jan-00 | Simpson, et al. | 204 | 612 | <i>NOV 28 2001</i> |
|  | | | | | | | |
| FOREIGN PATENT DOCUMENTS | | | | | | | |
| REF | DOCUMENT NUMBER | DATE | COUNTRY | CLASS | SUBCLASS | Translation | |
| | | | | | | YES | NO |
| <i>AN</i> | B1 | WO 00/02038 | 13-Jan-00 | WIPO | <i>601N</i> | <i>27/26</i> | |
| <i>AN</i> | B2 | WO 98/10122 | 12-Mar-98 | WIPO | <i>C25 B</i> | <i>9100</i> | |
|  | | | | | | | |
| OTHER DOCUMENTS <i>(Including Author, Title, Date, Pertinent Pages, Etc.)</i> | | | | | | | |
| <i>AN</i> | C1 | Shi, Y., et al. "Radial Capillary Array Electrophoresis Microplate and Scanner for High-Performance Nucleic Acid Analysis" <i>Analytical Chemistry, American Chemical Society, Columbus, US</i> volume 71, number 23, 1 December 1999, pages 5354-5361 XP-000902372 | | | | | |
| EXAMINER <i>Ab. Nagorela</i> | | | | DATE CONSIDERED <i>5/02/03</i> | | | |